


5" THICK STANDARD,
 6" THICK RESIDENTIAL,
 8" THICK COMMERCIAL AND INDUSTRIAL DRIVES
 3,500 PSI CONCRETE WALK



NOTES:

1. CONCRETE SHALL HAVE A MINIMUM STRENGTH OF 3,500 PSI AND MEET SECTION 501 OF THE VERMONT STANDARD SPECIFICATIONS FOR CLASS B CONCRETE.
2. HALF INCH (1/2") TRANSVERSE EXPANSION JOINTS SHALL BE PLACED AT INTERVALS NOT EXCEEDING TWENTY FEET (20'). SIDEWALKS SHALL BE SCORED EVERY FIVE FEET (5'). CURB AND SIDEWALK SECTIONS SHALL BE SEPARATED BY A PREMOLDED JOINT FILLER.
3. AFTER THE INITIAL CURING PERIOD IS OVER (APPROXIMATELY 28 DAYS) ALL EXPOSED SURFACES SHALL RECEIVE TWO COATS OF ANTI-SPALLING COMPOUND.
4. SEE WRITTEN SPECIFICATION FOR APPROVED CONSTRUCTION METHODS AND MATERIAL REQUIREMENTS.

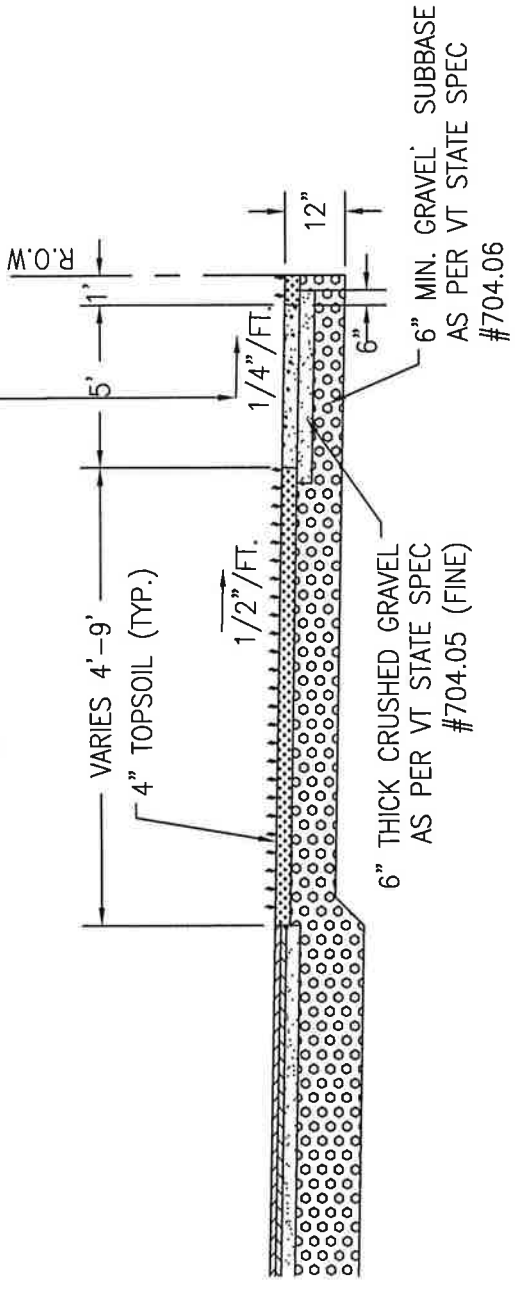

TOWN OF MILTON
 PUBLIC WORKS DEPARTMENT

SCALE: NTS
 DATE: FEB. 2008

DRAWING #: 12

DRAWN BY: FA&A

TYPICAL SIDEWALK